


- CLASS A BACKFILL: NATIVE OR COMMON MATERIAL WITH A 2" MIN. CROWN, COMPACTED TO 95% T-99.
- CLASS B BACKFILL: 1"-MINUS CRUSHED AGGREGATE, COMPACTED IN 8" LOOSE LIFTS TO 95% AASHTO T-99.
- CLASS C BACKFILL: CLEAN SAND, NO PARTICLE SIZE LARGER THAN 1/4 INCH.
- CLASS E BACKFILL: CONTROLLED LOW STRENGTH MATERIAL (CLSM).

WATER, SEWER, OR  
STORM PIPE MATERIAL  
AS SPECIFIED.

BEDDING AND PIPE ZONE SHALL BE  
TYPE A, B, C, OR D AS SPECIFIED,  
SEE STANDARD DETAIL 3800-2.

### NOTES:

1. ENGINEER WILL CONSIDER ADJUSTING USUAL TRENCH WIDTH TO ACCOMMODATE CONDITION ENCOUNTERED.
2. REFERENCE TECHNICAL SPEC. SECTION 3800.
3. FOR HMA TRENCH CAP SURFACE REPLACEMENT SEE DETAIL 3800-5.

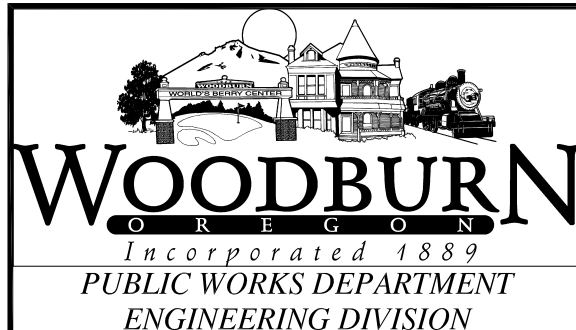

## PIPE TRENCH BACKFILL

REV: MARCH 2023

SCALE: NTS

DET No.

**3800-1**