



TABLE
CONCRETE/AGGREGATE BASE
THICKNESS AND REINFORCEMENT.

USE	CONC.	1" - MINUS CRUSHED AGGREGATE	REBAR
SINGLE FAMILY RESIDENTIAL	6"	4"	NONE
ALL OTHER	8"	6"	No.4 @ 12"O.C. EACH WAY

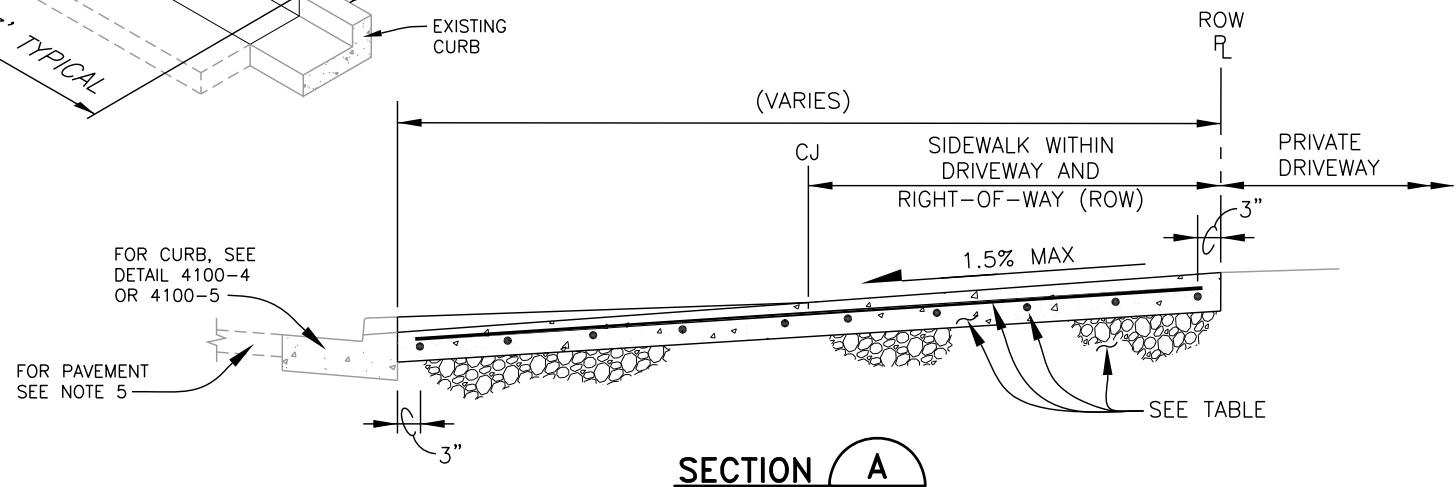

NOTES:

1. REFERENCE TECHNICAL SPEC. SECTION 4150.
2. EXPANSION JOINTS (EJ) SHALL BE 1/2" AC IMPREGNATED JOINT FILLER AT ALL DISSIMILAR VERTICAL SURFACES.
3. MATERIAL - 3500 PSI CONCRETE AT 28 DAYS.
4. CURBS WITH CRACKING, SETTLEMENT, DRAINAGE PROBLEMS OR SIGNIFICANT DETERIORATION SHALL BE REPLACED UNLESS APPROVED BY ENGINEERING DEPARTMENT.
5. ASPHALT STREETS SHALL BE REPAIRED TO FIX ANY OVERCUTS OR DAMAGE CAUSED BY PLACING CURB FORMS. REPAIR SHALL BE A MINIMUM OF 1FT WIDE AND THE ENTIRE LENGTH OF THE CURB REPLACEMENT AREA. ALL LIMITS SHALL BE CLEANLY SAW CUT.

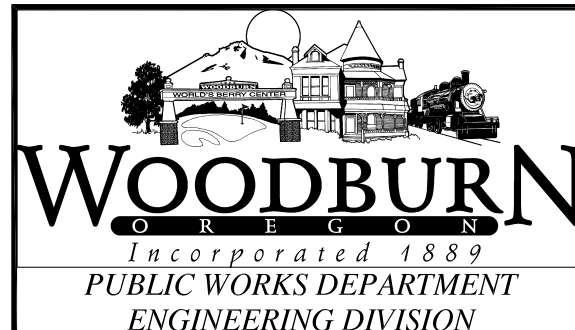

DRIVEWAY APPROACH

REV: AUG. 2020

SCALE: NTS

DET No.
4150-1