


PROPERTY LINE SIDEWALK

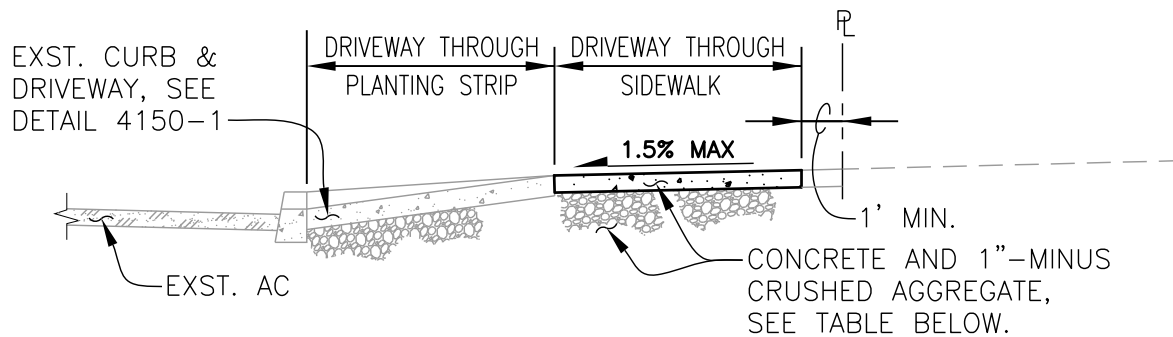


SECTION A

CONCRETE/AGGREGATE BASE
THICKNESS AND REINFORCEMENT.

NOTES:

1. REFERENCE TECHNICAL SPEC.
SECTION 4150.
2. PLACE CONSTRUCTION JOINTS AT
5' INTERVALS 1/3 THICKNESS.
3. MATERIAL - 3500 PSI CONCRETE
AT 28 DAYS.

USE	CONC.	1"-MINUS CRUSHED AGGREGATE	REBAR
SINGLE FAMILY RESIDENTIAL	6"	4"	NONE
ALL OTHER	8"	6"	No.4 @ 12"O.C. EACH WAY

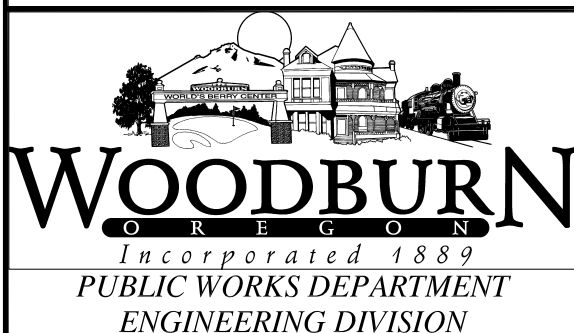

PROPERTY LINE SIDEWALK AT DRIVEWAY

REV: JUNE. 2018

SCALE: NTS

DET No.

4150-4