


EXPANSION JOINT

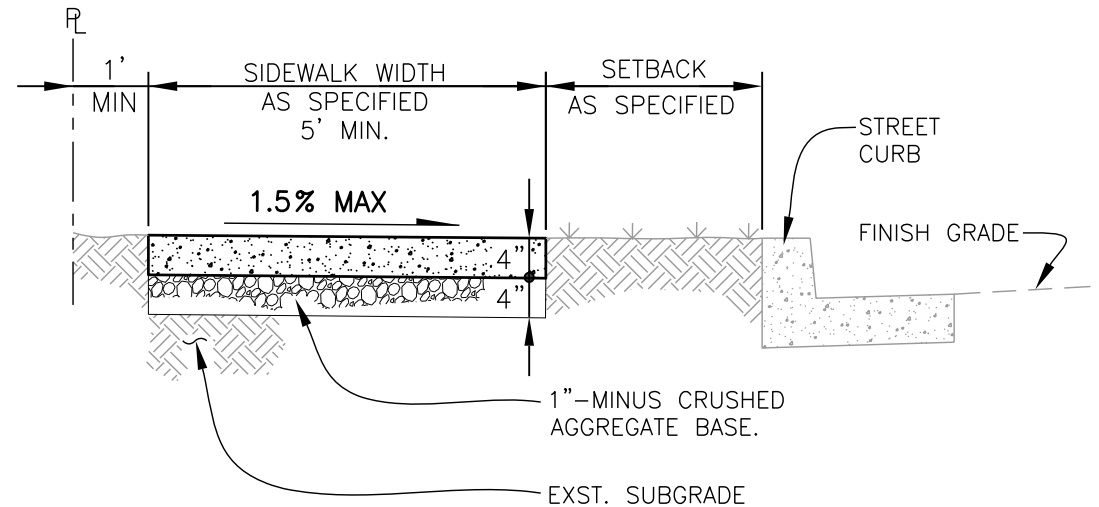

PROPERTY LINE SIDEWALK

NOTES:

1. MATERIAL – 3500 PSI CONCRETE AT 28 DAYS. BROOM FINISH SURFACE & PROVIDE 3" EDGE SHINE. REFERENCE TECHNICAL SPEC. SECTION 4150.
2. EXPANSION JOINTS (EJ) SHALL BE 1/2" AC IMPREGNATED JOINT FILLER AT ALL DISSIMILAR VERTICAL SURFACES.
3. TRANSVERSE CONSTRUCTION JOINTS (CJ) 1-1/2" DEEP OR 1/3 OF THE THICKNESS (T) @ 5' INTERVALS.
4. FOR SIDEWALK AT DRIVEWAYS SEE DETAILS 4150-3 AND 4150-4.



SIDEWALKS

REV: JULY 2018

SCALE: NTS

DET No.

4150-8