

VALVE BOX COVER SHALL
BE EAST JORDAN IRON
WORKS MODEL# 3639A1
OR APPROVED EQUAL.

ADJUST TO
FINISH GRADE

FINISH GRADE

18" VALVE BOX TOP
SECTION SHALL BE EAST
JORDAN IRON WORKS
MODEL# 3639Z1 18T
OR APPROVED EQUAL.

SLIDE VALVE BOX BOTTOM
SECTION SHALL BE 6-INCH
DIAMETER, SDR 35 PIPE OR
APPROVED EQUAL.


D.I. WATER MAIN

M.J. OR FLANGED
VALVE

CONCRETE PIER BLOCK POUR
ON UNDISTURBED EARTH, MIN.
AREA OF 2 SQ. FT. VALVE TO
HAVE TEMPORARY BLOCKING
DURING CURE.

NOTES:

1. REFERENCE TECHNICAL
SPEC. SECTION 5050.

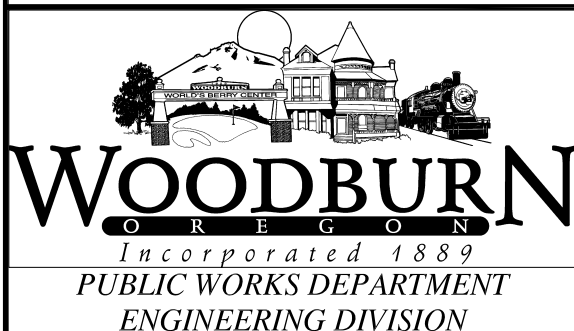

VALVE ASSEMBLY

REV: FEB. 2020

SCALE: NTS

DET No.

5050-2